

ಕರ್ನಾಟಕ



ಸರ್ಕಾರ

GOVERNMENT OF KARNATAKA

OFFICE OF THE DISTRICT FIRE OFFICER AMARGOL HUBLI - 580025

Telephone : 0836-2322555

Email: dfohubli@gmail.com

CNo:39/CC/DFO/AMR-HUBLI/2025.

Date: 07-07-2025.

To,

The President
Spoorti Charitable Trust®
Spoorti Central School
Karwar Road, Kalghatagi Taluk
Dharwad District.

Sub:- Issue the **Compliance Certificate** for the Fire Fighting and Fire
Precautionary to Spoorti Charitable Trust® Spoorti Central School
Karwar Road, Kalghatagi Taluk, Dharwad District.

Ref:- 1. C.No:38/ADV/DFO//2025 Date:05-07-2025

2. Applicant Request Letter dated 26-06-2025

3. CNo:02/CC/FSO/Kalaghatagi/2025 Date:05-07-2025


***@**

With the cited above subject this office issued Compliance Certificate for the Insatallation of Fire Fighting and fire precautionary measures to the Spoorti Charitable Trust® Spoorti Central School Karwar Road, Kalghatagi Taluk, Dharwad District. vide ref (1) cited above.

Wide ref (2) The applicant has been requested to issue the Compliance for the installation of Fire Fighting System.

As per ref (3), The school building was inspected by FSO Kalaghatagi on 05-07-2025. The installation of the Fire Fighting System Spoorti Charitable Trust® Spoorti Central School Karwar Road, Kalghatagi Taluk, Dharwad District. had installed all the Fire Precautionary measure.

Under the above circumstances the Karnataka State Fire & Emergency Service Department is issuing the Compliance Certificate to Spoorti Charitable Trust® Spoorti Central School Karwar Road, Kalghatagi Taluk, Dharwad District. The

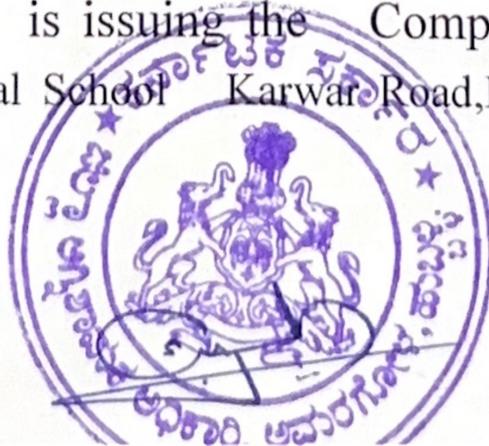


maintenance of the fire fighting systems carried out periodically and Arrange 40% in Fire Fighting & Evacuation measure within 03 months from the issue this report.

This Compliance Certificate is valid up to 06-07-2026 and its renewable.

Note:This letter is issued from the fire prevention and fire fighting point of view.The dept.will not endorse the ownership of the premises and not responsible for any disputes which may arise in due course.If at any time any of the conditions are found not complied with or removal of fire fighting systems,this Certificate shall stand withdrawn/cancelled.



Yours Faithfully

DISTRICT FIRE OFFICER
Karnataka State Fire
and Emergency Services
Fire Station, Amargol HUBBALLI-25.

ಕರ್ನಾಟಕ ಸರ್ಕಾರ
GOVERNMENT OF KARNATAKA

C.No:38/FSR/DFO/Amr-Hubli/2025.

Date: 04/07/2025

TO,

The President
Spoorti Charitable Trust®
Spoorti Central School
Karwar Road, Kalghatagi Taluk
Dharwad District.

Sir,

Sub: Issue of **Fire Safety recommendation/Advise'** to Spoorti Charitable Trust® Spoorti Central School Karwar Road, Kalghatagi Taluk Dharwad District.

Ref: 1) Request Letter Dated: 10-06-2025.

2) No.GBC(2)044/2020-21 dated 21/06/2022 S.O No.156-B.

3) C No-01/FSR/FSO/Kalghatagi/2025 Date:02-07-2025

With reference to the above cited, The premises Spoorti Charitable Trust® Spoorti Central School Karwar Road, Kalghatagi Taluk Dharwad District. Inspection Report Was inspected by FSO Kalghatagi on 02-07-2025. With respect to Fire prevention, Firefighting and Evacuation measures to be complied in the above premises and has submitted the details as under.

ANNEXURE-1

(Up to 14.99 mtrs. in height)

Group B Education Building

NBC-2016, Part-4, Table 7 (11) 3.1.3 Group B Educational Buildings sub division B1 & B2.

(These condition are indicative and not exclusive all relevant provisions related to fire and life safety of NBC 2016 are mandatory)

A. Details of the building/premises :-

S.No	Details	:	Observation
01	Name and Address of the Applicant.	:	The President Spoorti Charitable Trust® Spoorti Central School Karwar Road, Kalghatagi Taluk Dharwad District.



02	Name and Address of the premises.	:	Spoorti Central School R.S.No.149/2,Kalaghatagi Karwar Road,Kalghatagi Taluk Dharwad District.
03	Name and address of the Building owner	:	The President Spoorti Charitable Trust® Spoorti Central School Karwar Road,Kalghatagi Taluk Dharwad District.
04	Number of buildings	:	01 Building
05	Number of floors	:	Ground +03 Upper Floors
06	<u>Floor-wise details of occupancy:-</u>		
	Ground Floor	:	Administration Office-01,classrooms-05 & Toilet Bathroom section
	First Floor	:	Classrooms-05,Staff Room-01 & Toilet Bathroom section
	Second Floor	:	Classrooms-06 & Toilet Bathroom section
	Third Floor	:	MusicalRoom-01,ComputerLab-01,Library-01,ScienceLab-01,Maths Lab-01 & Toilet Bathroom section
07	Height of the building	:	14.4 Mtrs
08	Site area	:	8168.14 Sq.Mtrs.
09	Built-up area of each floor:-		
	Ground Floor	:	1222.26 Sq.Mtrs
	First Floor	:	452.34 Sq.Mtrs.
	Second Floor	:	452.34 Sq.Mtrs
	Third Floor	:	452.34 Sq.Mtrs
10.	Total built-up area	:	2579.28 Sq Mtrs
11.	Surrounding properties:-		
	East(F)	:	R.S.No.149/1
	West (R)	:	R.S.No.180
	North(S)	:	40.00mtr.wide National Highway Road
	South(S)	:	R.S.No.150
12.	<u>Set-back area available around the building :-</u>		
	East(F)	:	Min.04.00 Mtrs
	West (R)	:	Min.04.00 Mtrs
	North(S)	:	Min.04.00 Mtrs
	South(S)	:	Min.04.00 Mtrs



Allowed setbacks (open space) should be maintained free from further obstruction / construction

Note: Recommended to provide and maintain setbacks as per Local ZR.

B. on inspection of this Educational premises, the following fire prevention, fire fighting and evacuation measures recommended are considered absolutely essential from fire safety point of view:

Sl. No. (1)	Details (02)	Existing (03)	Recommendations (04)
01.	Accessibility to the premises	The premise is abutting by 18.00 mtrs. Wide hard surfaced road located on Eastern side.	Adequate
02.	No. of entrances	01, No's entrance of 06.00 Mtrs	Minimum 06.00 mtrs. width with height clearance of minimum 05.00 mtrs. from ground level.
03.	Width of entry / exit	Width of entry is 06.00 mtrs	Recommended to provide minimum 06.00 mtr width of one Entrance & one Exit
04	Diesel generators.	Not provided	Recommended to provided DG fo Min 25 KVA Capacity.
05	No. of staircase available	Nos. of Staircase : 03	Recommended to provide staircases maintaining travel distance with 22.50 mtrs. With minimum 02.00 mtrs. Width, 30 mm treads width, 15mm tread height 01 mtr Handrails with minimum 02.20 head room clearance
		Width of stircase : 1.50 Mtr	
		Width of treads : 30 cm	
		Height of risers : 10 cm	
		Nos. of risers per flight : 15	
		Height of handrails : 1 mtr	
		Head Room Clearance : 3.50 Mtr	
06	No. Lifts and capacity	Nos. of lifts : -	-
		Capacity of lifts : -	



07	Portable Fire extinguishers	Provided Fire extinguishers (ABC, CO ₂) required for 100 sq.mtrs. built up area.	Complied
08	Hose reel hose system	Hose Reel Hose system near the staircase (One hose reel hose system for every 1000 Sq. Mtr) .The hose reel hose of min. 19 mm sizes and of adequate length to reach the farthest point has been provided	Complied
09	Pump at the terrace tank level with minimum pressure of 3.5 kg/cm ² .	The System has been connected to a booster pump of 450 LPM or of 5 HP capacities.	. Complied
10	Terrace tank over respective tower terrace.	5000 ltrs RCC overhead Tank has been provided.	Complied
11	Escape routes	Fire exit signage board has been displayed.	Complied
12	Fire order (Fire safety plans)	Fire order Boardwith emergency telephone numbers of Kalaghatagi Fire station i.e. 08370-285101 & 101, 112 telephone numbers of the nearest Ambulance service & Police Station Has been displayed	Complied
13	No smoking board	COPTA Sec-4 direction No Smoking area smoking here is an offence board should be written in English & Kannada both language has been prominently displayed at inside the entry/exit	Complied



14	Fire Siren	Fire Siren installed in the Premises to inform the inmates in case of a Fire Emergency and Evacuate the area.	Complied
15	Fire fighting training	Not Trained	At-least 40% of employees shall be got trained in basic fire fighting at R.A.Mundkur fire & Emergency Services Academy, Bannerughatta road, Bangalore within 3 months or at an early date. And shall be submitted to this office.
16	<p>Fire precautionary measures:-</p> <p>A. Explosive and flammable materials should not be stored in the store room, UPS room, Electrical panel area, class rooms, laboratory & electrical sum panel premises.</p> <p>B. Accumulation of combustibile waste in and around the premises should be avoided.</p> <p>C. The exit ways shall be always kept clear without any obstruction.</p> <p>D. Liquefied petroleum gas should not be stored in the building.</p> <p>E. The doors shall not be kept locked/latched during working hours and shall be free from obstruction.</p> <p>F. During the class hours the class room doors shall not be locked from inside to outside.</p> <p>G. As per Hon'ble Supreme Court order all teachers and staffs shall be trained to handle safety equipment, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the Fire Safety Day on April 14th of every year by conducting Fire Safety drills with co-ordinate with fire service department.</p>		

Under the above circumstance the Karnataka Fire and Emergency service Department issuing **Fire Safety Recommendation** to Spoorti Charitable Trust® Spoorti Central School Karwar Road, Kalghatagi Taluk Dharwad District. subject to condition and compliance of the above recommendations in column 04 of serial B within 03 months compliance to the undersigned.



All requirements recommended above as per National Building Code-2016 Part-4 clause 3.1.4 Offire and Life safety will have to complied with mandatorily

From the above details it is clear that the '**Management**' of the above Eucational building have been recomnded to provide Fire precautionary measures as per **Building Code-2016 Part-4 clause 3.1.3 Group B Educational Building sub division B1 & B2** After full-filling the above recomandation a certificate should be obtained by this office.If at any time any of the conditionare found not complied with this certificate shall stand with drawn/cancelled.



Yours Faithfully


DISTRICT FIRE OFFICER
Karnataka State Fire
and Emergency Services
Fire Station, Amargol HUBBALLI-25.